



Ref. Certif. No.

DE 2-029479

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT  
(IECEE) CB SCHEME

## CB TEST CERTIFICATE

Product

LED GARDEN LIGHT

Name and address of the applicant

MIC Optoelectronic Co.,Ltd  
3rd floor, D building, 12# Jinyuan first road  
Heao, Henggang, Longgang district, Shenzhen, P.R. China

Name and address of the manufacturer

MIC Optoelectronic Co.,Ltd  
3rd floor, D building, 12# Jinyuan first road  
Heao, Henggang, Longgang district, Shenzhen, P.R. China

Name and address of the factory

MIC Optoelectronic Co.,Ltd  
3rd floor, D building, 12# Jinyuan first road  
Heao, Henggang, Longgang district, Shenzhen, P.R. China

Ratings and principal characteristics

AC 100-240V; 50/60Hz; ta45°C; IP66; Class I;  
For other ratings, see test report.

Trademark (if any)

Customer's Testing Facility (CTF) Stage used

N/A

Model / Type Ref.

MYL-A50; MYL-A75; MYL-A100; MYL-A120; MYL-A150

Additional information (if necessary may  
also be reported on page 2)

-see also test report ref. no. 60357043 001.

A sample of the product was tested and  
found to be in conformity with

IEC 60598-2-1:2020  
IEC 60598-1:2014+A1

As shown in the Test Report Ref. No. which  
forms part of this Certificate

60357043 001

This CB Test Certificate is issued by the National Certification Body



**TÜVRheinland®**

TÜV Rheinland LGA Products GmbH  
Tillystr. 2, 90431 Nürnberg, Germany  
Phone + 49 221 806-1371  
Fax + 49 221 806-3935  
Mail: cert-validity@de.tuv.com  
Web : www.tuv.com

Date: 2020-11-18

Signature:

Dipl.-Ing. Univ. S. O. Steinke



Test Report issued under the responsibility of:



**TEST REPORT**  
**IEC 60598-2-1**  
**Luminaires**  
**Part 2: Particular requirements**  
**Section 1: Fixed general purpose luminaires**

**Report Number..... :** 60357043 001

**Date of issue..... :** 16-11-2020

**Total number of pages ..... :** 38 pages

**Name of Testing Laboratory preparing the Report ..... :** TÜV Rheinland (Shenzhen) Co., Ltd.

**Applicant's name ..... :** MIC Optoelectronic Co.,Ltd

**Address..... :** 3rd floor, D building, 12# Jinyuan first road, Heao, Henggang, Longgang district, Shenzhen, P.R. China

**Test specification:**

**Standard ..... :** IEC 60598-2-1:2020 used in conjunction with IEC 60598-1:2014, AMD1:2017

**Test procedure ..... :** CB Scheme

**Non-standard test method ..... :** N/A

**Test Report Form No. .... :** IEC60598\_2\_1G

**Test Report Form(s) Originator .... :** Intertek Semko AB

**Master TRF ..... :** Dated 2020-06-02

**Copyright © 2020 IEC System of Conformity Assessment Schemes for Electrotechnical Equipment and Components (IECEE System). All rights reserved.**

This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.

**This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.**

**General disclaimer:**

The test results presented in this report relate only to the object tested.

This report shall not be reproduced, except in full, without the written approval of the Issuing CB Testing Laboratory. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.

<b>Test item description..... :</b>	LED GARDEN LIGHT	
<b>Trade Mark(s) ..... :</b>	N/A	
<b>Manufacturer ..... :</b>	Same as applicant	
<b>Model/Type reference ..... :</b>	MYL-A50; MYL-A75; MYL-A100; MYL-A120; MYL-A150	
<b>Ratings ..... :</b>	100-240V~, 50/60Hz, t <sub>a</sub> 45°C, IP66, Class I, details information see "General product information"	
<b>Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):</b>		
<input checked="" type="checkbox"/>	<b>CB Testing Laboratory:</b>	TÜV Rheinland (Shenzhen) Co., Ltd.
<b>Testing location/ address..... :</b>		1601 R&D Room, 1602-1604, 17-18F Building 7 Site C, Vanke Cloud City Phase I XingKe First Street, Xili Street, Xili Community, Nanshan District Shenzhen 518052 P.R. China
<b>Tested by (name, function, signature)..... :</b>		Wayne Wang
<b>Approved by (name, function, signature).... :</b>		Jack Li
<input type="checkbox"/>	<b>Testing procedure: CTF Stage 1:</b>	
<b>Testing location/ address..... :</b>		N/A
<b>Tested by (name, function, signature)..... :</b>		N/A
<b>Approved by (name, function, signature).... :</b>		N/A
<input type="checkbox"/>	<b>Testing procedure: CTF Stage 2:</b>	
<b>Testing location/ address..... :</b>		N/A
<b>Tested by (name + signature) ..... :</b>		N/A
<b>Witnessed by (name, function, signature) .. :</b>		N/A
<b>Approved by (name, function, signature).... :</b>		N/A
<input type="checkbox"/>	<b>Testing procedure: CTF Stage 3:</b>	
<input type="checkbox"/>	<b>Testing procedure: CTF Stage 4:</b>	
<b>Testing location/ address..... :</b>		N/A
<b>Tested by (name, function, signature)..... :</b>		N/A
<b>Witnessed by (name, function, signature) .. :</b>		N/A
<b>Approved by (name, function, signature).... :</b>		N/A
<b>Supervised by (name, function, signature) :</b>		N/A

**List of Attachments (including a total number of pages in each attachment):**

Attachment 1: Tests according to IEC 62031:2018. (1 page)

Attachment 2: Photobiological safety of lamps and lamp systems were according to standard IEC TR 62778:2014. (1 page)

Attachment 3: Photo document. (7 pages)

**Summary of testing:****Tests performed (name of test and test clause):**

Clause(s)	Test(s)
IEC 60598-2-1:2020 combined with IEC 60598-1:2014+A1:2017	
1.5 (3.4)	Rubbing test
1.6 (4.12.1)	Screw torque test
1.6 (4.13.1)	Impact test
1.6 (4.13.3)	Straight unjointed test finger
1.6 (4.14.1)	Test for mechanical suspensions
1.10 (5.2.10.3)	Cord anchorage test
1.11 (8.2.5)	Protection against electric shock tests
1.11 (8.2.6)	Covers reliably secured
1.11 (8.2.7)	Discharge test
1.13 (9.2)	Tests for ingress of dust, solid objects and moisture
1.13 (9.3)	Humidity test
1.14 (10.2.1)	Insulation resistance test
1.14 (10.2.2)	Electric strength test
1.14 (10.3)	Touch current test and protective conductor current test
1.7 (11)	Creepage distances and clearances
1.12 (12.3)	Endurance test
1.12 (12.4.1)	Thermal test
1.15 (13.2.1)	Ball pressure test
1.15 (13.3.1)	Needle flame test
1.15 (13.3.2)	Glow-wire test

Full test were performed on model MYL-A150.

**Testing location:**

TÜV Rheinland (Shenzhen) Co., Ltd.  
 1601 R&D Room, 1602-1604, 17-18F Building 7  
 Site C, Vanke Cloud City Phase I XingKe First  
 Street, Xili Street, Xili Community, Nanshan  
 District Shenzhen 518052 P.R. China

**Summary of compliance with National Differences (List of countries addressed):****List of countries addressed**

N/A

**Statement concerning the uncertainty of the measurement systems used for the tests**

(may be required by the product standard or client)

☐ **Internal procedure used for type testing through which traceability of the measuring uncertainty has been established:**

**Procedure number, issue date and title:**

Calculations leading to the reported values are on file with the NCB and testing laboratory that conducted the testing.

☒ **Statement not required by the standard used for type testing**

(Note: When IEC or ISO standard requires a statement concerning the uncertainty of the measurement systems used for tests, this should be reported above. The informative text in parenthesis should be delete in both cases after selecting the applicable option)

**Copy of marking plate:**

**The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.**

**Label located on the packaging or attached on the lamp:**

**LED GARDEN LIGHT**  
**Model: MYL-A150**  
**Input: 100-240V ~, 50/60Hz, 150W**  
**IP66**  $t_a$  45°C  
**MIC Optoelectronic Co.,Ltd**

Note 1: The height of letters and numerals is 2mm;

Note 2: The height of graphical symbols is 5 mm;

Note 3: The others' rating labels are only different from the model name and electrical parameter.



**General product information:**

Product: LED GARDEN LIGHT

Ratings: 100-240V~, 50/60Hz, IP66, ta=45°C Class I, Luminaire suitable for direct mounting on normally flammable surfaces, suitable for indoor and outdoor use.

1. This CB report is for IECEE registration only.
2. All models use LED modules 3030 (L130-xxxx003000x21), CCT 2200-6500K.
3. The SURFACE LED LIGHT connecting the supply mains via an external detachable LED driver, the supply connection method is Supply cord form the LED driver.
4. All models have the same construction and appearance except the power, LED driver and enclosure dimension.

**Model list:**

Model name	Power (W)	Size (DxHmm)	LED driver model No.
MYL-A50	50	Ø452x551	XLG-100-H-A
MYL-A75	75		XLG-100-H-A
MYL-A100	100		XLG-100-H-A
MYL-A120	120		XLG-150-H-A
MYL-A150	150		XLG-150-H-A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
<b>1.2 (0)</b>	<b>GENERAL TEST REQUIREMENTS</b>		<b>P</b>
1.2 (0.3)	More sections applicable..... :	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Section/s:	—
1.2 (0.5)	Components	(see Annex 1)	—
<b>1.2 (0.7)</b>	<b>Information for luminaire design in light sources standards</b>		—
1.2 (0.7.2)	Light source safety standard .....	IEC 62031	—
	Luminaire design in the light source safety standard		<b>P</b>

<b>1.4 (2)</b>	<b>CLASSIFICATION OF LUMINAIRES</b>		<b>P</b>
1.4 (2.2)	Type of protection .....	Class I	<b>P</b>
1.4 (2.3)	Degree of protection..... :	IP66	—
1.4 (2.4)	Luminaire suitable for direct mounting on normally flammable surfaces .....	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
1.4 (2.5)	Luminaire for normal use .....	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	—
	Luminaire for rough service .....	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	—

<b>1.5 (3)</b>	<b>MARKING</b>		<b>P</b>
1.5 (3.2)	Mandatory markings		<b>P</b>
	Position of the marking		<b>P</b>
	Format of symbols/text		<b>P</b>
1.5 (3.3)	Additional information		<b>P</b>
	Language of instructions	English	<b>P</b>
1.5 (3.3.1)	Combination luminaires		N/A
1.5 (3.3.2)	Nominal frequency in Hz	50/60Hz	<b>P</b>
1.5 (3.3.3)	Operating temperature		N/A
1.5 (3.3.5)	Wiring diagram		N/A
1.5 (3.3.6)	Special conditions		N/A
1.5 (3.3.7)	Metal halide lamp luminaire – warning		N/A
1.5 (3.3.8)	Limitation for semi-luminaires		N/A
1.5 (3.3.9)	Power factor and supply current		N/A
1.5 (3.3.10)	Suitability for use indoors		<b>P</b>
1.5 (3.3.11)	Luminaires with remote control		N/A
1.5 (3.3.12)	Clip-mounted luminaire – warning		N/A
1.5 (3.3.13)	Specifications of protective shields		N/A
1.5 (3.3.14)	Symbol for nature of supply	~	<b>P</b>



IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
1.5 (3.3.15)	Rated current of socket outlet		N/A
1.5 (3.3.16)	Rough service luminaire		N/A
1.5 (3.3.17)	Mounting instruction for type Y, type Z and some type X attachments	Type Y	P
1.5 (3.3.18)	Non-ordinary luminaires with PVC cable		N/A
1.5 (3.3.19)	Protective conductor current in instruction if applicable		N/A
1.5 (3.3.20)	Provided with information if not intended to be mounted within arm's reach		N/A
1.5 (3.3.21)	Non replaceable and non-user replaceable light sources information provided	Non-user replaceable light sources	P
1.5 (3.3.22)	Controllable luminaires, classification of insulation provided		N/A
1.5 (3.3.23)	Luminaire without controlgear provided with necessary information for selection of appropriate component		N/A
1.5 (3.3.24)	If not supplied with terminal block, information on the packaging		N/A
1.5 (3.4)	Test with water	15s	P
	Test with hexane	15s	P
	Legible after test		P
	Label attached		P

<b>1.6 (4)</b>	<b>CONSTRUCTION</b>		<b>P</b>
1.6 (4.2)	Components replaceable without difficulty		N/A
1.6 (4.3)	Wireways smooth and free from sharp edges		P
<b>1.6 (4.4)</b>	<b>Lampholders</b>		<b>N/A</b>
1.6 (4.4.1)	Integral lampholder		N/A
1.6 (4.4.2)	Wiring connection		N/A
1.6 (4.4.3)	Lampholder for end-to-end mounting		N/A
1.6 (4.4.4)	Positioning		N/A
	- pressure test (N) .....		—
	After test the lampholder comply with relevant standard sheets and show no damage		N/A
	After test on single-capped lampholder the lampholder have not moved from its position and show no permanent deformation		N/A
	- bending test (N) .....		—

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	After test the lampholder have not moved from its position and show no permanent deformation		N/A
1.6 (4.4.5)	Peak pulse voltage		N/A
1.6 (4.4.6)	Centre contact		N/A
1.6 (4.4.7)	Parts in rough service luminaires resistant to tracking		N/A
1.6 (4.4.8)	Lamp connectors		N/A
1.6 (4.4.9)	Caps and bases correctly used		N/A
1.6 (4.4.10)	Light source for lampholder or connection according IEC 60061 not connected another way		N/A
<b>1.6 (4.5)</b>	<b>Starter holders</b>		N/A
	Starter holder in luminaires other than class II		N/A
	Starter holder class II construction		N/A
<b>1.6 (4.6)</b>	<b>Terminal blocks</b>		<b>N/A</b>
	Tails		N/A
	Unsecured blocks		N/A
<b>1.6 (4.7)</b>	<b>Terminals and supply connections</b>		<b>N/A</b>
1.6 (4.7.1)	Contact to metal parts		N/A
1.6 (4.7.2)	Test 8 mm live conductor		N/A
	Test 8 mm earth conductor		N/A
1.6 (4.7.3)	Terminals for supply conductors		N/A
1.6 (4.7.3.1)	Welded method and material		N/A
	- stranded or solid conductor		N/A
	- spot welding		N/A
	- welding between wires		N/A
	- Type Z attachment		N/A
	- mechanical test according to 15.6.2		N/A
	- electrical test according to 15.6.3		N/A
	- heat test according to 15.6.3.2.3 and 15.6.3.2.4		N/A
1.6 (4.7.4)	Terminals other than supply connection		N/A
1.6 (4.7.5)	Heat-resistant wiring/sleeves		N/A
1.6 (4.7.6)	Multi-pole plug		N/A
	- test at 30 N		N/A
<b>1.6 (4.8)</b>	<b>Switches</b>		N/A
	- adequate rating		N/A
	- adequate fixing		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- polarized supply		N/A
	- compliance with IEC 61058-1 for electronic switches		N/A
<b>1.6 (4.9)</b>	<b>Insulating lining and sleeves</b>		N/A
1.6 (4.9.1)	Retainment		N/A
	Method of fixing .....		N/A
1.6 (4.9.2)	Insulated linings and sleeves:		N/A
	Resistant to a temperature > 20 °C to the wire temperature or		N/A
	a) & c) Insulation resistance and electric strength		N/A
	b) Ageing test. Temperature (°C) .....		N/A
<b>1.6 (4.10)</b>	<b>Double or reinforced insulation</b>		<b>N/A</b>
1.6 (4.10.1)	No contact, mounting surface – accessible metal parts – wiring of basic insulation		N/A
	Safe installation fixed luminaires		N/A
	Capacitors and switches		N/A
	Interference suppression capacitors according to IEC 60384-14		N/A
1.6 (4.10.2)	Assembly gaps:		N/A
	- not coincidental		N/A
	- no straight access with test probe		N/A
1.6 (4.10.3)	Retainment of insulation:		N/A
	- fixed		N/A
	- unable to be replaced; luminaire inoperative		N/A
	- sleeves retained in position		N/A
	- lining in lampholder		N/A
1.6 (4.10.4)	Protective impedance device		N/A
	Double or reinforced insulation bridged by appropriate and at least two resistors or two Y2 capacitors or one Y1 capacitor		N/A
	Y1 or Y2 capacitors comply with IEC 60384-14		N/A
	Resistors comply with test (a) in 14.1 of IEC 60065		N/A
<b>1.6 (4.11)</b>	<b>Electrical connections and current-carrying parts</b>		<b>P</b>
1.6 (4.11.1)	Contact pressure		P
1.6 (4.11.2)	Screws:		N/A
	- self-tapping screws		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- thread-cutting screws		N/A
1.6 (4.11.3)	Screw locking:		N/A
	- spring washer		N/A
	- rivets		N/A
1.6 (4.11.4)	Material of current-carrying parts		P
1.6 (4.11.5)	No contact to wood or mounting surface		P
1.6 (4.11.6)	Electro-mechanical contact systems		N/A
<b>1.6 (4.12)</b>	<b>Screws and connections (mechanical) and glands</b>		<b>P</b>
1.6 (4.12.1)	Screws not made of soft metal		P
	Screws of insulating material		N/A
	Torque test: torque (Nm); part..... :	Fixed glass cover: 1,2Nm	P
	Torque test: torque (Nm); part..... :	Fixed LED lens: 0,5Nm	P
	Torque test: torque (Nm); part..... :	Fixed LED PCB: 0,5Nm	P
	Torque test: torque (Nm); part..... :	Fixed cord anchorage: 0,5Nm	P
	Torque test: torque (Nm); part..... :	Fixed enclosure of LED driver: 1,2Nm	P
	Torque test: torque (Nm); part..... :	Fixed enclosure of LED driver: 0,6Nm	P
1.6 (4.12.2)	Screws with diameter < 3 mm screwed into metal		N/A
1.6 (4.12.4)	Locked connections:		N/A
	- fixed arms; torque (Nm) ..... :		N/A
	- lampholder; torque (Nm) ..... :		N/A
	- push-button switches; torque 0,8 Nm ..... :		N/A
1.6 (4.12.5)	Screwed glands; force (Nm)..... :	Metal gland: 6,25Nm	N/A
<b>1.6 (4.13)</b>	<b>Mechanical strength</b>		<b>P</b>
1.6 (4.13.1)	Impact tests:		P
	- fragile parts; energy (Nm) ..... :		N/A
	- other parts; energy (Nm)..... :	0,35Nm, for metal enclosure and LED lens	P
	1) live parts		P
	2) linings		N/A
	3) protection		P
	4) covers		P
1.6 (4.13.2)	Metal parts have adequate mechanical strength		N/A
1.6 (4.13.3)	Straight test finger	30N	P

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
1.6 (4.13.4)	Rough service luminaires		N/A
	- IP54 or higher		N/A
	a) fixed		N/A
	b) hand-held		N/A
	c) delivered with a stand		N/A
	d) for temporary installations and suitable for mounting on a stand		N/A
1.6 (4.13.6)	Tumbling barrel		N/A
<b>1.6 (4.14)</b>	<b>Suspensions, fixings and means of adjusting</b>		<b>P</b>
1.6 (4.14.1)	Mechanical load:		P
	A) four times the weight	For model MYL-A150: Max. 7,8Kgx4=31,2Kg	P
	B) torque 2,5 Nm		N/A
	C) bracket arm; bending moment (Nm)..... :		N/A
	D) load track-mounted luminaires		N/A
	E) clip-mounted luminaires, glass-shelve. Thickness (mm) .....		N/A
	Metal rod. diameter (mm) .....		N/A
	Fixed luminaire or independent control gear without fixing devices		N/A
1.6 (4.14.2)	Load to flexible cables		N/A
	Mass (kg) .....		—
	Stress in conductors (N/mm <sup>2</sup> ) .....		N/A
	Mass (kg) of semi-luminaire .....		N/A
	Bending moment (Nm) of semi-luminaire .....		N/A
1.6 (4.14.3)	Adjusting devices:		N/A
	- flexing test; number of cycles..... :		N/A
	- strands broken .....		N/A
	- electric strength test afterwards		N/A
1.6 (4.14.4)	Telescopic tubes: cords not fixed to tube; no strain on conductors		N/A
1.6 (4.14.5)	Guide pulleys		N/A
1.6 (4.14.6)	Strain on socket-outlets		N/A
<b>1.6 (4.15)</b>	<b>Flammable materials</b>		<b>P</b>
	- glow-wire test 650°C .....	See Test Table 1.15 (13.3.2)	P
	- spacing ≥30 mm		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- screen withstanding test of 13.3.1		N/A
	- screen dimensions		N/A
	- no fiercely burning material		P
	- thermal protection		N/A
	- electronic circuits exempted		N/A
1.6 (4.15.2)	Luminaires made of thermoplastic material with lamp control gear		N/A
	a) construction		N/A
	b) temperature sensing control		N/A
	c) surface temperature		N/A
<b>1.6 (4.16)</b>	<b>Luminaires for mounting on normally flammable surfaces</b>		<b>P</b>
	No lamp control gear ..... :	(compliance with Section 12)	N/A
	Provided with adaptor for a track meet the requirements for direct mounting on normally flammable surfaces		N/A
1.6 (4.16.1)	Lamp control gear spacing:		P
	- spacing 35 mm		N/A
	- spacing 10 mm		P
1.6 (4.16.2)	Thermal protection:		N/A
	- in lamp control gear		N/A
	- external		N/A
	- fixed position		N/A
	- temperature marked lamp control gear		N/A
1.6 (4.16.3)	Design to satisfy the test of 12.6	(see clause 12.6)	N/A
<b>1.6 (4.17)</b>	<b>Drain holes</b>		N/A
	Clearance at least 5 mm		N/A
<b>1.6 (4.18)</b>	<b>Resistance to corrosion</b>		<b>P</b>
1.6 (4.18.1)	- rust-resistance		P
1.6 (4.18.2)	- season cracking in copper		N/A
1.6 (4.18.3)	- corrosion of aluminium		P
1.6 (4.19)	Ignitors compatible with ballast		N/A
1.6 (4.20)	Rough service vibration		N/A
<b>1.6 (4.21)</b>	<b>Protective shield</b>		N/A
1.6 (4.21.1)	Shield fitted if tungsten halogen lamps or metal halide lamps		N/A
	Shield of glass if tungsten halogen lamps		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
1.6 (4.21.2)	Particles from a shattering lamp not impair safety		N/A
1.6 (4.21.3)	No direct path		N/A
1.6 (4.21.4)	Impact test on shield		N/A
	Glow-wire test on lamp compartment..... :	See Test Table 1.15 (13.3.2)	N/A
1.6 (4.22)	Attachments to lamps not cause overheating or damage		N/A
1.6 (4.23)	Semi-luminaires comply Class II	Not semi-luminaire	N/A
<b>1.6 (4.24)</b>	<b>Photobiological hazards</b>		<b>P</b>
1.6 (4.24.1)	No excessive UV radiation if tungsten halogen lamps and metal halide lamps (Annex P)		N/A
1.6 (4.24.2)	Retinal blue light hazard		P
	Class of risk group assessed according to IEC/TR 62778 ..... :	RG1	—
	Luminaires with $E_{thr}$ :		N/A
	a) Fixed luminaires		N/A
	- distance x m, borderline between RG1 and RG2 .. :		N/A
	- marking and instruction according 3.2.23		N/A
	b) Portable and handheld luminaires		N/A
	- marking according 3.2.23 if RG1 exceeded at 200 mm according to IEC/TR 62778		N/A
	Portable luminaires for children IEC 60598-2-10 and Mains socket outlet nightlights IEC 60598-2-12 not exceed RG1 at 200 mm according to IEC/62778		N/A
<b>1.6 (4.25)</b>	<b>Mechanical hazard</b>		<b>P</b>
	No sharp point or edges		P
<b>1.6 (4.26)</b>	<b>Short-circuit protection</b>		N/A
1.6 (4.26.1)	Adequate means of uninsulated accessible SELV parts		N/A
1.6 (4.26.2)	Short-circuit test with test chain according 4.26.3		N/A
	Test chain not melt through		N/A
	Test sample not exceed values of Table 12.1 and 12.2		N/A
<b>1.6 (4.27)</b>	<b>Terminal blocks with integrated screwless earthing contacts</b>		N/A
	Test according Annex V		N/A
	Pull test of terminal fixing (20 N)		N/A
	After test, resistance < 0,05 $\Omega$		N/A
	Pull test of mechanical connection (50 N)		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	After test, resistance < 0,05 $\Omega$		N/A
	Voltage drop test, resistance < 0,05 $\Omega$		N/A
<b>1.6 (4.28)</b>	<b>Fixing of thermal sensing control</b>		N/A
	Not plug-in or easily replaceable type		N/A
	Reliably kept in position		N/A
	No adhesive fixing if UV radiations from a lamp can degrade the fixing		N/A
	Not outside the luminaire enclosure		N/A
	Test of adhesive fixing:		N/A
	Max. temperature on adhesive material (°C) ..... :		—
	100 cycles between t min and t max		N/A
	Temperature sensing control still in position		N/A
<b>1.6 (4.29)</b>	<b>Luminaires with non-replaceable light source</b>		<b>N/A</b>
	Not possible to replace light source		N/A
	Live part not accessible after parts have been opened by hand or tools		N/A
<b>1.6 (4.30)</b>	<b>Luminaires with non-user replaceable light source</b>		<b>P</b>
	If protective cover provide protection against electric shock and marked with “caution, electric shock risk” symbol:		P
	Minimum two fixing means		P
<b>1.6 (4.31)</b>	<b>Insulation between circuits</b>		<b>P</b>
	Circuits insulated from LV supply fulfil requirements according 4.31.1 – 4.31.3		P
	Controllable luminaires requiring same level of insulation for all components, the insulation between control terminals and LV supply fulfil requirements according 4.31.1 – 4.31.3		N/A
<b>1.6 (4.31.1)</b>	<b>SELV circuits</b>		<b>P</b>
	Used SELV source		P
	Voltage $\leq$ ELV		P
	Insulating of SELV circuits from LV supply		P
	Insulating of SELV circuits from other non SELV circuits		N/A
	Insulating of SELV circuits from FELV		N/A
	Insulating of SELV circuits from other SELV circuits		N/A
	SELV circuits insulated from accessible parts according Table X.1		P



IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Plugs not able to enter socket-outlets of other voltage systems		N/A
	Socket outlets does not admit plugs of other voltage systems		N/A
	Plugs and socket-outlets does not have protective conductor contact		N/A
1.6 (4.31.2)	FELV circuits		N/A
	Used FELV source		N/A
	Voltage $\leq$ ELV		N/A
	Insulating of FELV circuits from LV supply		N/A
	FELV circuits insulated from accessible parts according Table X.1		N/A
	Plugs not able to enter socket-outlets of other voltage systems		N/A
	Socket outlets does not admit plugs of other voltage systems		N/A
	Socket-outlets does not have protective conductor contact		N/A
1.6 (4.31.3)	Other circuits		N/A
	Other circuits insulated from accessible parts according Table X.1		N/A
	Class II construction with equipotential bonding for protection against indirect contacts with live parts:		N/A
	- conductive parts are connected together		N/A
	- test according 7.2.3		N/A
	- conductive part not cause an electric shock in case of an insulation fault		N/A
	- equipotential bonding in master/slave applications		N/A
	- master luminaire provided with terminal for accessible conductive parts of slave luminaires		N/A
	- slave luminaire constructed as class I		N/A
1.6 (4.32)	<b>Overvoltage protective devices</b>		N/A
	Comply with IEC 61643-11		N/A
	External to controlgear and connected to earth:		N/A
	- only in fixed luminaires		N/A
	- only connected to protective earth		N/A
1.7 (11)	<b>CREEPAGE DISTANCES AND CLEARANCES</b>		P

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
1.7 (11.2.1)	Impulse withstand category (Normal category II)	Category II <input checked="" type="checkbox"/> Category III <input type="checkbox"/>	—
	Category III according Annex U		N/A
	Protected against pollution, reduced creepage and clearance according Annex P of IEC 61347-1		N/A
1.7 (11.2.2)	Creepage distances for frequency up to 30 kHz	See Test Table 1.7 (11.2) I	P
	Creepage distances for frequency over 30 kHz:		N/A
	- Controlgear marked with $\hat{U}_{OUT}$ and $f_{UOUT}$ according IEC 61347-1, clause 7.1, item w	See Test Table 1.7 (11.2) II	N/A
	- Requirements according IEC 60664-4 for controlgear not covered by IEC 61347	See Test Table 1.7 (11.2) II	N/A
1.7 (11.2.3)	Clearances for frequency up to 30 kHz	See Test Table 1.7 (11.2) I	P
	Clearances distances for frequency over 30 kHz:		N/A
	- Controlgear marked with $U_P$	See Test Table 1.7 (11.2) II	N/A
	- Requirements according IEC 60664-4 for controlgear not covered by IEC 61347	See Test Table 1.7 (11.2) II	N/A

<b>1.8 (7)</b>	<b>PROVISION FOR EARTHING</b>		<b>P</b>
1.8 (7.2.1 + 7.2.3)	Accessible metal parts		P
	Metal parts in contact with supporting surface		P
	Resistance < 0,5 $\Omega$ ..... : 0,05 $\Omega$		P
	Self-tapping screws used		P
	Thread-forming screws		N/A
	Thread-forming screw used in a grove		N/A
	Earth makes contact first		N/A
	Terminal blocks with integrated screwless earthing contacts tested according Annex V		N/A
	Protective earthing of the luminaire not via built-in control gear		N/A
1.8 (7.2.2 + 7.2.3)	Earth continuity in joints, etc.		P
1.8 (7.2.4)	Locking of clamping means		P
	Compliance with 4.7.3		P
	Terminal blocks with integrated screwless earthing contacts tested according Annex V		N/A
1.8 (7.2.5)	Earth terminal integral part of connector socket		N/A
1.8 (7.2.6)	Earth terminal adjacent to mains terminals		P

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
1.8 (7.2.7)	Electrolytic corrosion of the earth terminal		P
1.8 (7.2.8)	Material of earth terminal		P
	Contact surface bare metal		P
1.8 (7.2.10)	Class II luminaire for looping-in		N/A
	Double or reinforced insulation to functional earth		N/A
1.8 (7.2.11)	Earthing core coloured green-yellow		P
	Length of earth conductor		P
<b>1.9 (14)</b>	<b>SCREW TERMINALS</b>		N/A
	Separately approved; component list	(see Annex 1)	N/A
	Part of the luminaire	(see Annex 3)	N/A
<b>1.9 (15)</b>	<b>SCREWLESS TERMINALS AND ELECTRICAL CONNECTIONS</b>		N/A
	Separately approved; component list..... :	(see Annex 1)	N/A
	Part of the luminaire ..... :	(see Annex 4)	N/A
<b>1.10 (5)</b>	<b>EXTERNAL AND INTERNAL WIRING</b>		<b>P</b>
<b>1.10 (5.2)</b>	<b>Supply connection and external wiring</b>		<b>P</b>
1.10 (5.2.1)	Means of connection ..... :	Supply cord	P
	Outdoor luminaire has not PVC insulated external wiring if not class III or SELV $\leq 25$ V a.c./60 V d.c. or protected from outdoor environment		N/A
1.10 (5.2.2)	Type of cable ..... :	H05RN-F	P
	Nominal cross-sectional area (mm <sup>2</sup> ) ..... :	3x1,0mm <sup>2</sup>	P
	Cables equal to IEC 60227 or IEC 60245		P
1.10 (5.2.3)	Type of attachment, X, Y or Z	Type Y	P
1.10 (5.2.5)	Type Z not connected to screws		N/A
1.10 (5.2.6)	Cable entries:		P
	- suitable for introduction		P
	- adequate degree of protection		P
1.10 (5.2.7)	Cable entries through rigid material have rounded edges		P
1.10 (5.2.8)	Insulating bushings:		N/A
	- suitably fixed		N/A
	- material in bushings		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- material not likely to deteriorate		N/A
	- tubes or guards made of insulating material		N/A
1.10 (5.2.9)	Locking of screwed bushings		N/A
1.10 (5.2.10)	Cord anchorage:		P
	- covering protected from abrasion		P
	- clear how to be effective		P
	- no mechanical or thermal stress		P
	- no tying of cables into knots etc.		P
	- insulating material or lining		P
1.10 (5.2.10.1)	Cord anchorage for type X attachment:		N/A
	a) at least one part fixed		N/A
	b) types of cable		N/A
	c) no damaging of the cable		N/A
	d) whole cable can be mounted		N/A
	e) no touching of clamping screws		N/A
	f) metal screw not directly on cable		N/A
	g) replacement without special tool		N/A
	Glands not used as anchorage		N/A
	Labyrinth type anchorages		N/A
1.10 (5.2.10.2)	Adequate cord anchorage for type Y and type Z attachment	Type Y	P
1.10 (5.2.10.3)	Tests:		P
	- impossible to push cable; unsafe		P
	- pull test: 25 times; pull (N) ..... : 60		P
	- torque test: torque (Nm) ..... : 0,25		P
	- displacement $\leq 2$ mm	Max 0,7mm	P
	- no movement of conductors		P
	- no damage of cable or cord		P
	- function independent of electrical connection		N/A
1.10 (5.2.11)	External wiring passing into luminaire		N/A
1.10 (5.2.12)	Looping-in terminals		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
1.10 (5.2.13)	Wire ends not tinned		N/A
	Wire ends tinned: no cold flow		P
1.10 (5.2.14)	Mains plug same protection		N/A
	Class III luminaire plug		N/A
	No unsafe compatibility		N/A
1.10 (5.2.16)	Appliance inlets (IEC 60320)		N/A
	Installation couplers (IEC 61535)		N/A
	Other appliance inlet or connector according relevant IEC standard		N/A
1.10 (5.2.17)	No standardized interconnecting cables properly assembled		N/A
1.10 (5.2.18)	Used plug in accordance with		N/A
	- IEC 60083		N/A
	- other standard		N/A
<b>1.10 (5.3)</b>	<b>Internal wiring</b>		<b>P</b>
1.10 (5.3.1)	Internal wiring of suitable size and type	See Annex 1	P
	Through wiring		N/A
	- not delivered/ mounting instruction		N/A
	- factory assembled		N/A
	- socket outlet loaded (A) ..... :		N/A
	- temperatures ..... : (see Annex 2)		N/A
	Green-yellow for earth only		N/A
1.10 (5.3.1.1)	Internal wiring connected directly to fixed wiring		P
	Cross-sectional area (mm <sup>2</sup> ) ..... :	See Annex 1	P
	Insulation thickness (mm) ..... :	See Annex 1	P
	Extra insulation added where necessary		N/A
1.10 (5.3.1.2)	Internal wiring connected to fixed wiring via internal current-limiting device		P
	Cross-sectional area (mm <sup>2</sup> ) ..... :	See Annex 1	P
1.10 (5.3.1.3)	Double or reinforced insulation for class II		P
1.10 (5.3.1.4)	Conductors without insulation		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
1.10 (5.3.1.5)	SELV current-carrying parts		P
1.10 (5.3.1.6)	Insulation thickness other than PVC or rubber		N/A
1.10 (5.3.2)	Sharp edges etc.		P
	No moving parts of switches etc.		N/A
	Joints, raising/lowering devices		N/A
	Telescopic tubes etc.		N/A
	No twisting over 360°		P
1.10 (5.3.3)	Insulating bushings:		N/A
	- suitable fixed		N/A
	- material in bushings		N/A
	- material not likely to deteriorate		N/A
	- cables with protective sheath		N/A
1.10 (5.3.4)	Joints and junctions effectively insulated		N/A
1.10 (5.3.5)	Strain on internal wiring		N/A
1.10 (5.3.6)	Wire carriers		N/A
1.10 (5.3.7)	Wire ends not tinned		N/A
	Wire ends tinned: no cold flow		P
<b>1.10 (5.4)</b>	<b>Test to determine suitability of conductors having a reduced cross-sectional area</b>		N/A
	Under test the temperature of the luminaire wiring insulation not exceed the limits stated in Table 12.2	(see Annex 2)	N/A
	No damage to luminaire wiring after test		N/A

<b>1.11 (8)</b>	<b>PROTECTION AGAINST ELECTRIC SHOCK</b>		P
1.11 (8.2.1)	Live parts not accessible		P
	Basic insulated parts not used on the outer surface without appropriate protection		P
	Basic insulated parts not accessible with standard test finger on portable, settable and adjustable luminaires		N/A
	Basic insulated parts not accessible with Ø 50 mm probe from outside, other types of luminaires		P
	Lamp and starterholders in portable and adjustable luminaires comply with double or reinforced insulation requirements		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Basic insulation only accessible under lamp or starter replacement		N/A
	Protection in any position		P
	Double-ended tungsten filament lamp		N/A
	Insulation lacquer not reliable		N/A
	Double-ended high-pressure discharge lamp		N/A
	Relevant warning according to 3.2.18 fitted to the luminaire		N/A
1.11 (8.2.2)	Portable luminaire adjusted in most unfavourable position		N/A
1.11 (8.2.3.a)	Class II luminaire:		N/A
	- basic insulated metal parts not accessible during starter or lamp replacement		N/A
	- basic insulation not accessible other than during starter or lamp replacement		N/A
	- glass protective shields not used as supplementary insulation		N/A
1.11 (8.2.3.b)	BC lampholder of metal in class I luminaires shall be earthed		N/A
1.11 (8.2.3.c)	SELV circuits with exposed current carrying parts:		N/A
	Ordinary luminaire:		N/A
	- voltage under load (V)..... :		N/A
	- no-load voltage (V)..... :		N/A
	- touch current if applicable (mA) ..... :		N/A
	One conductive part insulated if required		N/A
	Other than ordinary luminaire:		N/A
	- nominal voltage (V) ..... :		N/A
	Class III luminaire only for connection to SELV		N/A
	Class III luminaire not provided with means for protective earthing		N/A
1.11 (8.2.4)	Portable luminaire has protection independent of supporting surface		N/A
1.11 (8.2.5)	Compliance with the standard test finger or relevant probe		P
1.11 (8.2.6)	Covers reliably secured		P
1.11 (8.2.7)	Luminaire other than below with capacitor > 0,5 $\mu$ F not exceed 50 V 1 min after disconnection	4V	P

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Portable luminaire with capacitor > 0,1 $\mu$ F (0.25) not exceed 34 V 1 s after disconnection		N/A
	Other luminaires with capacitor > 0,1 $\mu$ F (0.25) with plug and track adaptors not exceed 60 V 5 s after disconnection		N/A

<b>1.12 (12)</b>	<b>ENDURANCE TEST AND THERMAL TEST</b>		<b>P</b>
1.12 (-)	If IP > IP 20 relevant test of (12.4), (12.5) and (12.6) after (9.2) before (9.3) specified in 1.13		—
<b>1.12 (12.2)</b>	<b>Selection of lamps and ballasts</b>		—
	Lamp used according Annex B	(Lamp used see Annex 2)	—
	Controlgear if separate and not supplied	(Controlgear used see Annex 2)	—
<b>1.12 (12.3)</b>	<b>Endurance test</b>		<b>P</b>
	a) mounting-position .....	According to manual instruction	—
	b) test temperature (°C) .....	55	—
	c) total duration (h) .....	240	—
	d) supply voltage (V) .....	1,1x240V=264V	—
	d) if not equipped with controlgear, constant voltage/current (V) or (A) .....	--	—
	e) luminaire ceases to operate	--	—
1.12 (12.3.2)	After endurance test:		<b>P</b>
	- no part unserviceable		<b>P</b>
	- luminaire not unsafe		<b>P</b>
	- no damage to track system		N/A
	- marking legible		<b>P</b>
	- no cracks, deformation etc.		<b>P</b>
<b>1.12 (12.4)</b>	<b>Thermal test (normal operation)</b>	(see Annex 2)	<b>P</b>
<b>1.12 (12.5)</b>	<b>Thermal test (abnormal operation)</b>	(see Annex 2)	N/A
<b>1.12 (12.6)</b>	<b>Thermal test (failed lamp control gear condition):</b>		N/A
1.12 (12.6.1)	Through wiring or looping-in wiring loaded by a current of (A) .....		—
	- case of abnormal conditions .....		—
	- electronic lamp control gear		N/A
	- measured winding temperature (°C): at 1,1 Un .....		—



IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- measured mounting surface temperature (°C) at 1,1 Un .....		N/A
	- calculated mounting surface temperature (°C) .....		N/A
	- track-mounted luminaires		N/A
1.12 (12.6.2)	Temperature sensing control		N/A
	- case of abnormal conditions .....		—
	- thermal link		N/A
	- manual reset cut-out		N/A
	- auto reset cut-out		N/A
	- measured mounting surface temperature (°C) .....		N/A
	- track-mounted luminaires		N/A
<b>1.12 (12.7)</b>	<b>Thermal test (failed lamp control gear in plastic luminaires):</b>		N/A
1.12 (12.7.1)	Luminaire without temperature sensing control		N/A
1.12 (12.7.1.1)	Luminaire with fluorescent lamp ≤ 70W		N/A
	Test method 12.7.1.1 or Annex W .....		—
	Test according to 12.7.1.1:		N/A
	- case of abnormal conditions .....		—
	- Ballast failure at supply voltage (V) .....		—
	- Components retained in place after the test		N/A
	- Test with standard test finger after the test		N/A
	Test according to Annex W:		N/A
	- case of abnormal conditions .....		—
	- measured winding temperature (°C): at 1,1 Un .....		—
	- measured temperature of fixing point/exposed part (°C): at 1,1 Un .....		—
	- calculated temperature of fixing point/exposed part (°C) .....		—
	Ball-pressure test .....	See Test Table 1.15 (13.2.1)	N/A
1.12 (12.7.1.2)	Luminaire with discharge lamp, fluorescent lamp > 70W, transformer > 10 VA		N/A
	- case of abnormal conditions .....		—
	- measured winding temperature (°C): at 1,1 Un .....		—

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- measured temperature of fixing point/exposed part (°C): at 1,1 Un .....		—
	- calculated temperature of fixing point/exposed part (°C) .....		—
	Ball-pressure test .....	See Test Table 1.15 (13.2.1)	N/A
1.12 (12.7.1.3)	Luminaire with short circuit proof transformers ≤ 10 VA		N/A
	- case of abnormal conditions .....		—
	- Components retained in place after the test		N/A
	- Test with standard test finger after the test		N/A
1.12 (12.7.2)	Luminaire with temperature sensing control		N/A
	- thermal link .....	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
	- manual reset cut-out .....	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
	- auto reset cut-out .....	Yes <input type="checkbox"/> No <input type="checkbox"/>	—
	- case of abnormal conditions .....		—
	- highest measured temperature of fixing point/ exposed part (°C): .....		—
	Ball-pressure test: .....	See Test Table 1.15 (13.2.1)	N/A

<b>1.13 (9)</b>	<b>RESISTANCE TO DUST AND MOISTURE</b>		<b>P</b>
1.13 (-)	If IP > IP 20 the order of tests as specified in clause 1.12		N/A
1.13 (9.2)	Tests for ingress of dust, solid objects and moisture:		<b>P</b>
	- classification according to IP .....	IP66	—
	- mounting position during test .....	According to manual instruction	—
	- fixing screws tightened; torque (Nm) .....	Fixed glass cover, Fixed enclosure of LED driver: 0,8Nm; Metal gland: 4,16Nm	—
	- tests according to clauses .....	Clause 9.2.2 and 9.2.7	—
	- electric strength test afterwards	Details see clause 10.2.2	<b>P</b>
	a) no deposit in dust-proof luminaire		N/A
	b) no talcum in dust-tight luminaire		<b>P</b>
	c) no trace of water on current-carrying parts or on insulation where it could become a hazard		<b>P</b>
	c.1) For luminaires without drain holes – no water entry		<b>P</b>

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	c.2) For luminaires with drain holes – no hazardous water entry		N/A
	d) no water in watertight or pressure watertight luminaire		N/A
	e) no contact with live parts (IP 2X)		N/A
	e) no entry into enclosure (IP 3X and IP 4X)		N/A
	e) no contact with live parts through drain holes and ventilation slots (IP3X and IP4X)		N/A
	f) no trace of water on part of lamp requiring protection from splashing water		N/A
	g) no damage of protective shield or glass envelope		N/A
1.13 (9.3)	Humidity test 48 h	25°C, 93% R.H	P

<b>1.14 (10)</b>	<b>INSULATION RESISTANCE AND ELECTRIC STRENGTH</b>		<b>P</b>
1.14 (10.2.1)	Insulation resistance test		P
	Cable or cord covered by metal foil or replaced by a metal rod of mm Ø .....	covered by metal foil	—
	Insulation resistance (MΩ) .....		—
	SELV		P
	- between current-carrying parts of different polarity :	100MΩ > 1MΩ	P
	- between current-carrying parts and mounting surface..... :	100MΩ > 1MΩ	P
	- between current-carrying parts and metal parts of the luminaire .....	100MΩ > 1MΩ	P
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :		N/A
	- Insulation bushings as described in Section 5 .....		N/A
	Other than SELV		P
	- between live parts of different polarity .....	LED driver approved	P
	- between live parts and mounting surface .....	100MΩ > 2MΩ	P
	- between live parts and metal parts .....	100MΩ > 2MΩ;	P
	- between live parts of different polarity through action of a switch..... :		N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts..... :	100MΩ > 2MΩ	P

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- Insulation bushings as described in Section 5 ..... :		N/A
1.14 (10.2.2)	Electric strength test		P
	Dummy lamp		N/A
	Luminaires with ignitors after 24 h test		N/A
	Luminaires with manual ignitors		N/A
	Test voltage (V) ..... :		P
	SELV		P
	- between current-carrying parts of different polarity :	500V	P
	- between current-carrying parts and mounting surface ..... :	500V	P
	- between current-carrying parts and metal parts of the luminaire ..... :	500V	P
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts ..... :		N/A
	- Insulation bushings as described in Section 5 ..... :		N/A
	Other than SELV		P
	- between live parts of different polarity ..... :	LED driver approved	P
	- between live parts and mounting surface ..... :	1480V	P
	- between live parts and metal parts ..... :	1480V	P
	- between live parts of different polarity through action of a switch ..... :		N/A
	- between the outer surface of a flexible cord or cable where it is clamped in a cord anchorage and accessible metal parts ..... :	1480V	P
	- Insulation bushings as described in Section 5 ..... :		N/A
1.14 (10.3)	Touch current or protective conductor current (mA):	Protective conductor current: 0,07mA < 3,5mA	P

<b>1.15 (13)</b>	<b>RESISTANCE TO HEAT, FIRE AND TRACKING</b>		<b>P</b>
1.15 (13.2.1)	Ball-pressure test ..... :	See Test Table 1.15 (13.2.1)	P
1.15 (13.3.1)	Needle-flame test (10 s) ..... :	See Test Table 1.15 (13.3.1)	N/A
1.15 (13.3.2)	Glow-wire test (650°C) ..... :	See Test Table 1.15 (13.3.2)	P
1.15 (13.4)	Proof tracking test (IEC 60112) ..... :	See Test Table 1.15 (13.4)	N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict

1.7 (11.2)	TABLE I: Creepage distances and clearances						P
	Minimum distances (mm) for a.c. up to 30 kHz sinusoidal voltages						P
	Applicable part of IEC 60598-1 Table 11.1.A*, 11.1.B* and 11.2*						P
	Insulation type **	Measured clearance	Required		Measured creepage	Required	
			clearance	*Table		creepage	*Table
Distance 1:	B	1,6	0,5	11.1.B	1,6	1,3	11.1.B
Working voltage (V) .....					240V		—
PTI .....					< 600 ☒      ≥ 600 ☐		—
Pulse voltage or $U_P$ if applicable (kV) .....					--		—
Supplementary information: Between live parts of different polarity of LED module Approved SELV LED driver XLG-150-H-A, Max, 60Vdc output							
Distance 2:	B	7,6	1,5	11.1B	7,6	2,5	11.1A
Working voltage (V) .....					240V		—
PTI .....					< 600 ☒      ≥ 600 ☐		—
Pulse voltage or $U_P$ if applicable (kV) .....					--		—
Supplementary information: Between live parts and accessible metal parts							
Distance 3:	B	7,6	1,5	11.1B	7,6	2,5	11.1A
Working voltage (V) .....					240V		—
PTI .....					< 600 ☒      ≥ 600 ☐		—
Pulse voltage or $U_P$ if applicable (kV) .....					--		—
Supplementary information: Between Live part and the supporting surface							

\*\* Insulation type: B – Basic; S – Supplementary; R – Reinforced. See also IEC 60598-1 Annex M.

<b>1.7 (11.2)</b>	<b>TABLE II: Creepage distances and clearances</b>						<b>N/A</b>
	<b>Minimum distances (mm) for a.c. higher than 30 kHz sinusoidal voltages</b>						
	<b>Applicable part of IEC 61347-1 Table 7 and 8* or IEC 60664-4 Table 1 and 2</b>						
Distances	Insulation type **	Measured clearance	Required		Measured creepage	Required	
			clearance	*Table		creepage	*Table
Distance 1:	--	--	--	--	--	--	--
Working voltage (V) .....					--		—
Frequency if applicable (kHz) .....					--		—
PTI .....					< 600 <input type="checkbox"/> ≥ 600 <input type="checkbox"/>		—

IEC 60598-2-1							
Clause	Requirement + Test				Result - Remark		Verdict
Peak value of the working voltage $\hat{U}_{out}$ if applicable (kV) .....					--		—
Supplementary information:							
Distance 2:	--	--	--	--	--	--	--
Working voltage (V) .....					--		—
Frequency if applicable (kHz) .....					--		—
PTI .....					< 600 <input type="checkbox"/> ≥ 600 <input type="checkbox"/>		—
Peak value of the working voltage $\hat{U}_{out}$ if applicable (kV) .....					--		—
Supplementary information:							
Distance 3:	--	--	--	--	--	--	--
Working voltage (V) .....					--		—
Frequency if applicable (kHz) .....					--		—
PTI .....					< 600 <input type="checkbox"/> ≥ 600 <input type="checkbox"/>		—
Peak value of the working voltage $\hat{U}_{out}$ if applicable (kV) .....					--		—
Supplementary information:							

\*\* Insulation type: B – Basic; S – Supplementary; R – Reinforced.

IEC 60598-2-1				
Clause	Requirement + Test		Result - Remark	Verdict
1.15 (13.2.1)	TABLE: Ball Pressure Test of Thermoplastics			P
Allowed impression diameter (mm) ..... :		2		—
Object/ Part No./ Material		Manufacturer/ trademark	Test temperature (°C)	Impression diameter (mm)
LED lens		See Annex 1	103	0,8
Supplementary information:--				

<b>1.15 (13.3.1)</b>	<b>TABLE: Needle-flame test (IEC 60695-11-5)</b>				<b>P</b>
Object/ Part No./ Material	Manufacturer/ trademark	Duration of application of test flame (ta); (s)	Ignition of specified layer Yes/No	Duration of burning (tb) (s)	Verdict
--	--	--	--	--	--
Supplementary information:--					

1.15 (13.3.2)	TABLE: Glow-wire test (IEC 60695-2-11)				P
Glow wire temperature ..... :			650°C		—
Object/ Part No./ Material	Manufacturer/ trademark		Ignition of specified layer Yes/No	Duration of burning (tb) (s)	Verdict
LED lens	See Annex 1		No	0	P
Supplementary information:--					

<b>1.15 (13.4)</b>	<b>TABLE: Proof tracking test (IEC 60112)</b>				<b>N/A</b>
<b>Test voltage PTI .....</b>		<b>175 V</b>	<b>—</b>		
Object/ Part No./ Material	Manufacturer/ trademark	Withstand 50 drops without failure on three places or on three specimens			Verdict
--	--	--	--	--	--
Supplementary information:--					

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 1	TABLE: Critical components information						P
Object / part No.	Code	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity <sup>1)</sup>	
Supply cord	B	Dong Guan Recheer Electric Wire & Cable Co., Ltd.	H05RN-F, H07RN-F	3x1.0mm <sup>2</sup>	EN 50525-2-21	VDE 40015173	
LED driver	B	MEAN WELL Enterprises Co., Ltd.	XLG-100-H-A	Input: 100-240Vac; 50/60Hz; 1,1A Output: 27-56Vdc; Max. 60Vdc; 1,75-2,8A; 100W; ta:50°C(100-200V ac); ta:60°C(200-240V ac); tc:90°C; IP67; Independent, Class I; SELV	IEC 61347-1 IEC 61347-2-13	DEKRA CB NL-58175	
LED driver	B	MEAN WELL Enterprises Co., Ltd.	XLG-150-H-A	Input: 100-240Vac; 50/60Hz; 2,0A Output: 27-56Vdc; Max. 60Vdc; 2,68-4,17A; 150W; ta:40°C(100-200V ac); ta:55°C(200-240V ac); tc:90°C; IP67; Independent, Class I; SELV	IEC 61347-1 IEC 61347-2-13	DEKRA CB NL-58676	
Connection device	B	Shenzhen Lilutong Electronic Technology Co.,Ltd	LLT-M15-15003M3054; LLT-M15-15003F3064	AC 250V; 15A; 1,0mm <sup>2</sup> ; IP67; 105°C	EN 61984	TUV SUD B 15 03 90230 002	
Input wire of LED	B	Dong Guan Recheer Electric Wire & Cable Co., Ltd.	H05RN-F, H07RN-F	2x1.0mm <sup>2</sup>	EN 50525-2-21	VDE 40015173	
LED PCB	C	NINGBO KJPCB ELECTRONIC TECHNOLOGY CO LTD	KJ-01	V-0, 100°C	IEC 60598-1 IEC 60598-2-1	UL E474795 Tested with appliance	
LED chip	C	LUMILEDS	L130-xxxx003000x21	IF: 240mA; VF: 5,8-6,6V; CCT: 2200-6500K	IEC/TR 62778	Tested with appliance	



IEC 60598-2-1						
Clause	Requirement + Test			Result - Remark		Verdict
LED lens	C	TEIJIN Chemicals Plastic Compounds Shanghai Ltd	L- 1225U(#)(f1), L- 1225V(#)(f1), L- 1225Z(#1)(f1)	PC; V-2; 115°C	IEC 60598- 1 IEC 60598- 2-5	UL E244324 Test with appliance
<p>Supplementary information:</p> <p><sup>1)</sup> Provided evidence ensures the agreed level of compliance. See OD-CB2039.</p> <p>The codes above have the following meaning:</p> <p>A - The component is replaceable with another one, also certified, with equivalent characteristics</p> <p>B - The component is replaceable if authorised by the test house</p> <p>C - Integrated component tested together with the appliance</p> <p>D - Alternative component</p>						

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict

ANNEX 2	TABLE: Thermal tests of Section 12		P
	Type reference .....	MYL-A150	—
	Lamp used.....	LED module	—
	Lamp control gear used.....	XLG-150-H-A	—
	Mounting position of luminaire .....	Normal mounting	—
	Supply wattage (W) .....	152,6	—
	Supply current (A) .....	0,621	—
	Temperatures in test 1 - 4 below are corrected for ta (°C) .....	45	—
	- abnormal operating mode .....	--	—
1.12 (12.4)	- test 1: rated voltage .....	240V	—
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage or 1,1 times constant voltage/current .....	254,4V	—
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage.....	--	—
	Through wiring or looping-in wiring loaded by a current of A during the test .....	--	—
1.12 (12.5)	- test 4: 1,1 times rated voltage or 1,05 times rated wattage or 1,1 times constant voltage/current.....	--	—

#### Temperature measurements (°C)

Part	Ambient	Cl. 12.4 – normal				Cl. 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
Supply cord	45	--	51,2	--	90	--	--
Connection device for input wire of LED driver	45	--	49,8	--	105	--	--
tc of LED driver	45	72,4	--	--	90	--	--
Connection device for output wire of LED driver	45	--	52,5	--	90	--	--
Input wire near LED	45	--	78,1	--	90	--	--
LED PCB	45	--	79,8	--	Ref.	--	--
LED lens	45	--	77,5	--	Ref.	--	--
Glass cover	45	--	68,2	--	90	--	--
Metal cover	45	--	66,7	--	Ref.	--	--

IEC 60598-2-1							
Clause	Requirement + Test			Result - Remark			Verdict
Mounting surface	45	--	46,3	--	90	--	--
Lighting surface (10cm)	45	--	53,6	--	90	--	--
Supplementary information:--							

IEC 60598-2-1							
Clause	Requirement + Test				Result - Remark		Verdict
ANNEX 2	TABLE: Thermal tests of Section 12						P
	Type reference .....			MYL-A100		—	
	Lamp used.....			LED module		—	
	Lamp control gear used.....			XLG-100-H-A		—	
	Mounting position of luminaire .....			Normal mounting		—	
	Supply wattage (W) .....			106,2		—	
	Supply current (A) .....			0,443		—	
	Temperatures in test 1 - 4 below are corrected for ta (°C) .....			45		—	
	- abnormal operating mode .....			--		—	
1.12 (12.4)	- test 1: rated voltage .....			240V		—	
	- test 2: 1,06 times rated voltage or 1,05 times rated wattage or 1,1 times constant voltage/current .....			--		—	
	- test 3: Load on wiring to socket-outlet, 1,06 times voltage or 1,05 times wattage.....			--		—	
	Through wiring or looping-in wiring loaded by a current of A during the test .....			--		—	
1.12 (12.5)	- test 4: 1,1 times rated voltage or 1,05 times rated wattage or 1,1 times constant voltage/current.....			--		—	
Temperature measurements (°C)							
Part	Ambient	Cl. 12.4 – normal				Cl. 12.5 – abnormal	
		test 1	test 2	test 3	limit	test 4	limit
tc of LED driver	45	77,8	--	--	90	--	--
Supplementary information:--							

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
<b>ANNEX 3</b>	<b>Screw terminals (part of the luminaire)</b>		N/A
<b>(14)</b>	<b>SCREW TERMINALS</b>		N/A
(14.2)	Type of terminal..... :		—
	Rated current (A)..... :		—
(14.3.2.1)	One or more conductors		N/A
(14.3.2.2)	Special preparation		N/A
(14.3.2.3)	Terminal size		N/A
	Cross-sectional area (mm <sup>2</sup> )..... :		—
(14.3.3)	Conductor space (mm)..... :		N/A
(14.4)	Mechanical tests		
(14.4.1)	Minimum distance		N/A
(14.4.2)	Cannot slip out		N/A
(14.4.3)	Special preparation		N/A
(14.4.4)	Nominal diameter of thread (metric ISO thread) ..... :	M	N/A
	External wiring		N/A
	No soft metal		N/A
(14.4.5)	Corrosion		N/A
(14.4.6)	Nominal diameter of thread (mm) ..... :		N/A
	Torque (Nm) ..... :		N/A
(14.4.7)	Between metal surfaces		N/A
	Lug terminal		N/A
	Mantle terminal		N/A
	Pull test; pull (N) ..... :		N/A
(14.4.8)	Without undue damage		N/A

IEC 60598-2-1			
Clause	Requirement + Test	Result - Remark	Verdict
<b>ANNEX 4</b>	<b>Screwless terminals (part of the luminaire)</b>		N/A
<b>(15)</b>	<b>SCREWLESS TERMINALS</b>		N/A
(15.2)	Type of terminal..... :		—
	Rated current (A)..... :		—
(15.3.1)	Material		N/A
(15.3.2)	Clamping		N/A
(15.3.3)	Stop		N/A
(15.3.4)	Unprepared conductors		N/A
(15.3.5)	Pressure on insulating material		N/A
(15.3.6)	Clear connection method		N/A
(15.3.7)	Clamping independently		N/A
(15.3.8)	Fixed in position		N/A
(15.3.10)	Conductor size		N/A
	Type of conductor		N/A
(15.5)	Terminals and connections for internal wiring		N/A
(15.5.1)	Mechanical tests		N/A
(15.5.1.1.1)	Pull test spring-type terminals (4 N, 4 samples) .....		N/A
(15.5.1.1.2)	Pull test pin or tab terminals (4 N, 4 samples) .....		N/A
	Insertion force not exceeding 50 N		N/A
(15.5.1.2)	Permanent connections: pull-off test (20 N)		N/A
(15.5.2)	Electrical tests		
	Voltage drop (mV) after 1 h (4 samples) .....		N/A
	Voltage drop of two inseparable joints		N/A
	Number of cycles:		—
	Voltage drop (mV) after 10th alt. 25th cycle (4 samples)..... :		N/A
	Voltage drop (mV) after 50th alt. 100th cycle (4 samples)..... :		N/A
	After ageing, voltage drop (mV) after 10th alt. 25th cycle (4 samples) .....		N/A
	After ageing, voltage drop (mV) after 50th alt. 100th cycle (4 samples) .....		N/A
(15.6)	Terminals and connections for external wiring		N/A
(15.6.1)	Conductors		N/A
	Terminal size and rating		N/A

IEC 60598-2-1										
Clause	Requirement + Test					Result - Remark				Verdict
15.6.2	Mechanical tests									N/A
(15.6.2.1)	Pull test spring-type terminals or welded connections (4 samples); pull (N) ..... :									N/A
(15.6.2.2)	Pull test pin or tab terminals (4 samples); pull (N) ..... :									N/A
(15.6.3)	Electrical tests									N/A
	Tests according 15.6.3.1 + 15.6.3.2 in IEC 60598-1									N/A
(15.6.3.1) (15.6.3.2)	TABLE: Contact resistance test / Heating tests									N/A
	Voltage drop (mV) after 1 h									—
terminal	1	2	3	4	5	6	7	8	9	10
voltage drop (mV)	--	--	--	--	--	--	--	--	--	--
	Voltage drop of two inseparable joints									N/A
	Voltage drop after 10th alt. 25th cycle									N/A
	Max. allowed voltage drop (mV) ..... :									—
terminal	1	2	3	4	5	6	7	8	9	10
voltage drop (mV)	--	--	--	--	--	--	--	--	--	--
	Voltage drop after 50th alt. 100th cycle									N/A
	Max. allowed voltage drop (mV) ..... :									—
terminal	1	2	3	4	5	6	7	8	9	10
voltage drop (mV)	--	--	--	--	--	--	--	--	--	--
	Continued ageing: voltage drop after 10th alt. 25th cycle									N/A
	Max. allowed voltage drop (mV) ..... :									—
terminal	1	2	3	4	5	6	7	8	9	10
voltage drop (mV)	--	--	--	--	--	--	--	--	--	--
	Continued ageing: voltage drop after 50th alt. 100th cycle									N/A
	Max. allowed voltage drop (mV) ..... :									—
terminal	1	2	3	4	5	6	7	8	9	10
voltage drop (mV)	--	--	--	--	--	--	--	--	--	--
										N/A
Supplementary information:										

<b>Attachment 1 Tests according to IEC 62031: 2018</b>			
Clause	Requirement + Test	Result - Remark	Verdict
<b>12 (14)</b>	<b>FAULT CONDITIONS</b>		<b>P</b>
<b>12.2</b>	<b>Overpower condition</b>		<b>P</b>
	Module withstands overpower condition >15 min.		P
	Module with automatic protective device or power limiter, test performed 15 min. at limit.		N/A
	No fire, smoke or flammable gas is produced		P
	Molten material does not ignite tissue paper, spread below the module		P
<b>22</b>	<b>PHOTOBIOLOGICAL SAFETY</b>		<b>P</b>
<b>22.1</b>	<b>UV radiation</b>		<b>N/A</b>
	Luminous radiation not exceed 2mW/klm		N/A
<b>22.2</b>	<b>Blue light hazard</b>		<b>P</b>
	Assessed according to IEC TR 62778	RG1	P
<b>22.3</b>	<b>Infrared radiation</b>		<b>N/A</b>
	Requirements for infrared radiation when required		N/A



Attachment 2		Photobiological safety of lamps and lamp systems were according to standard IEC TR 62778:2014		
Clause	Requirement + Test		Result - Remark	Verdict
	Measurement performed on:		<input type="checkbox"/> LED package <input checked="" type="checkbox"/> LED module <input type="checkbox"/> Lamp <input checked="" type="checkbox"/> Luminaire	
	Model number .....		MYL-A150	
	Test voltage (V) .....		240	--
	Test current (mA) .....		--	--
	Test frequency (Hz) .....		50	--
	Ambient, t (° C) .....		25,0	--
	Measurement distance .....		<input checked="" type="checkbox"/> 20 cm <input type="checkbox"/> ... cm	--
	Source size .....		<input checked="" type="checkbox"/> Non-small <input type="checkbox"/> Small : .... mm	--
	Field of view .....		<input type="checkbox"/> 100 mrad <input checked="" type="checkbox"/> 11 mrad <input type="checkbox"/> 1,7 mrad (for small sources)	--
Item	Symbol	Units	Result	Remark
Correlated colour temperature	CCT	K	6386	--
x/y colour coordinates		--	--	--
Blue light hazard radiance	L <sub>B</sub>	W/(m <sup>2</sup> •sr <sup>1</sup> )	405	RG1
Blue light hazard irradiance	E <sub>B</sub>	W/m <sup>2</sup>	--	--
Luminance	L	cd/m <sup>2</sup>	6,067E+05	--
Illuminance	E	lx	--	--

Attachment 3	Photo document.
--------------	-----------------



Figure 1. Over view of model MYL-A150



Figure 2. Over view of model MYL-A150

Attachment 3	Photo document.
--------------	-----------------



Figure 3. Gland view for supply cord



Figure 4. Internal view of model MYL-A150





Attachment 3	Photo document.
--------------	-----------------



Figure 7. Internal view of model MYL-A150

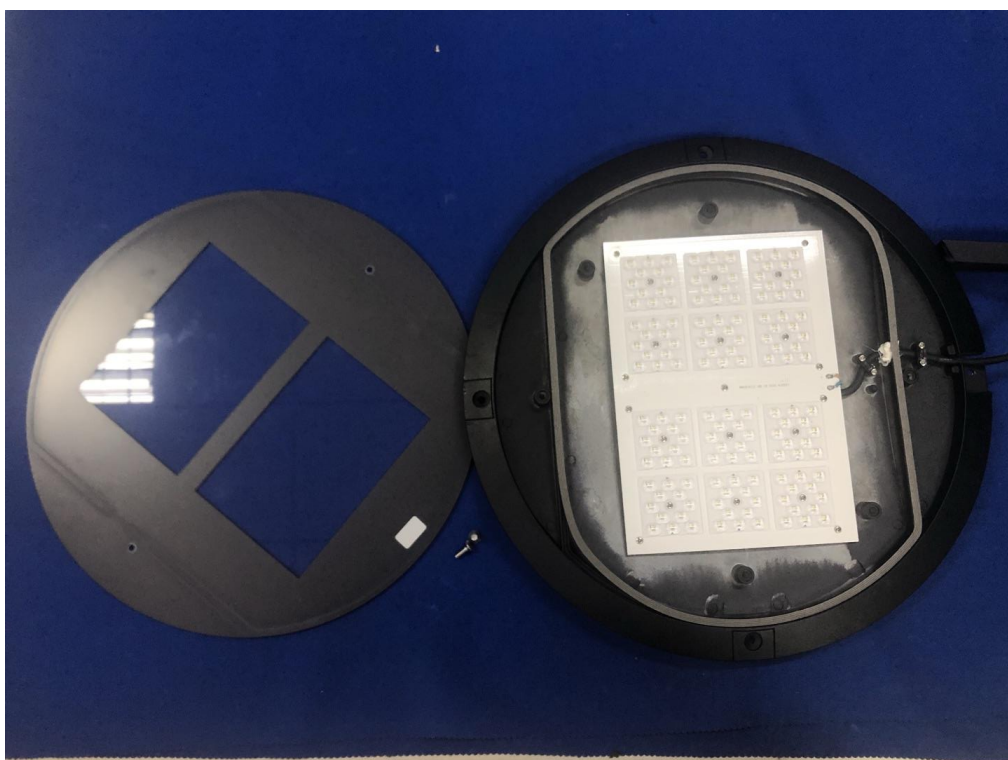


Figure 8. Internal view of model MYL-A150



Attachment 3	Photo document.
--------------	-----------------

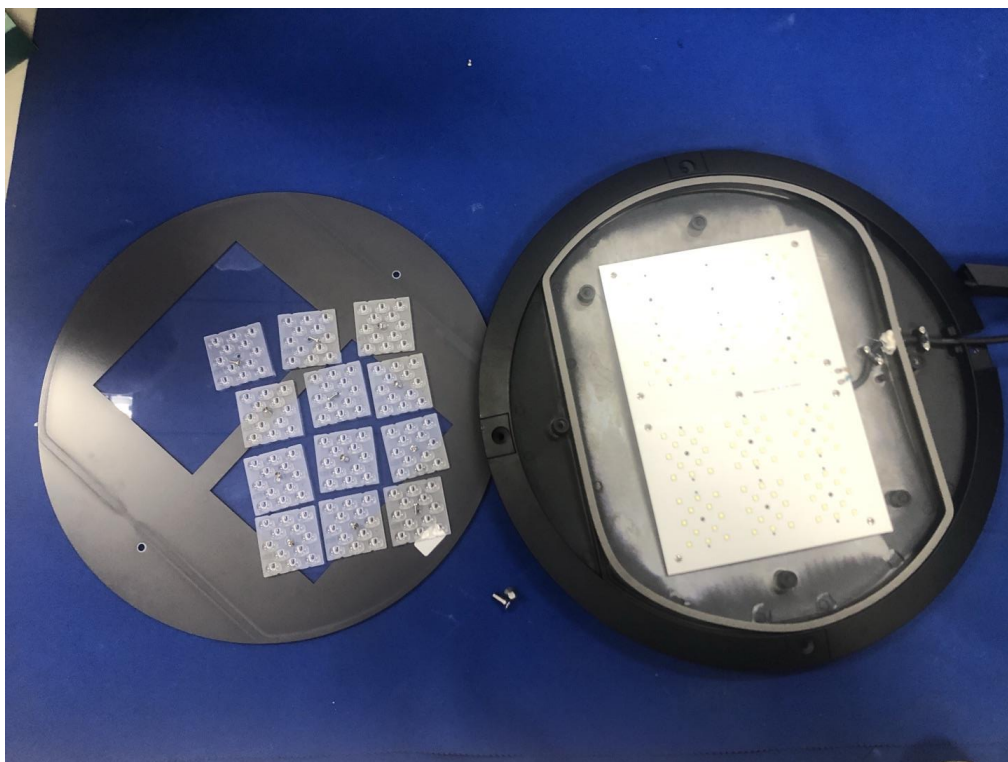


Figure 9. Internal view of model MYL-A150

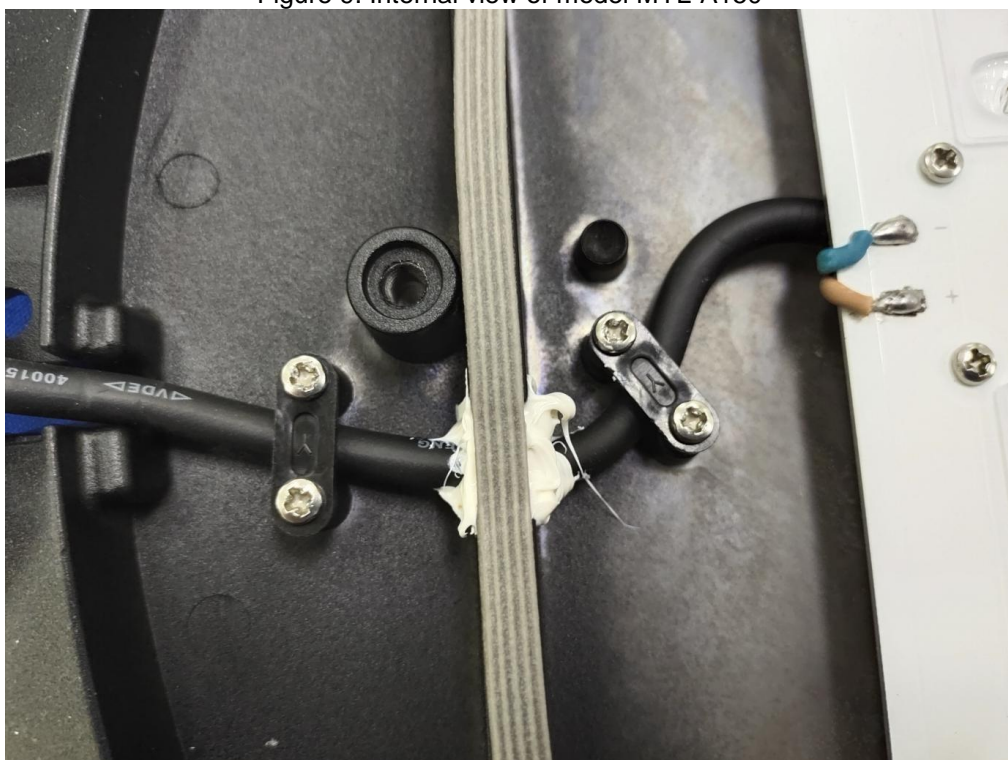


Figure 10. Internal view of model MYL-A150

Attachment 3 | Photo document.

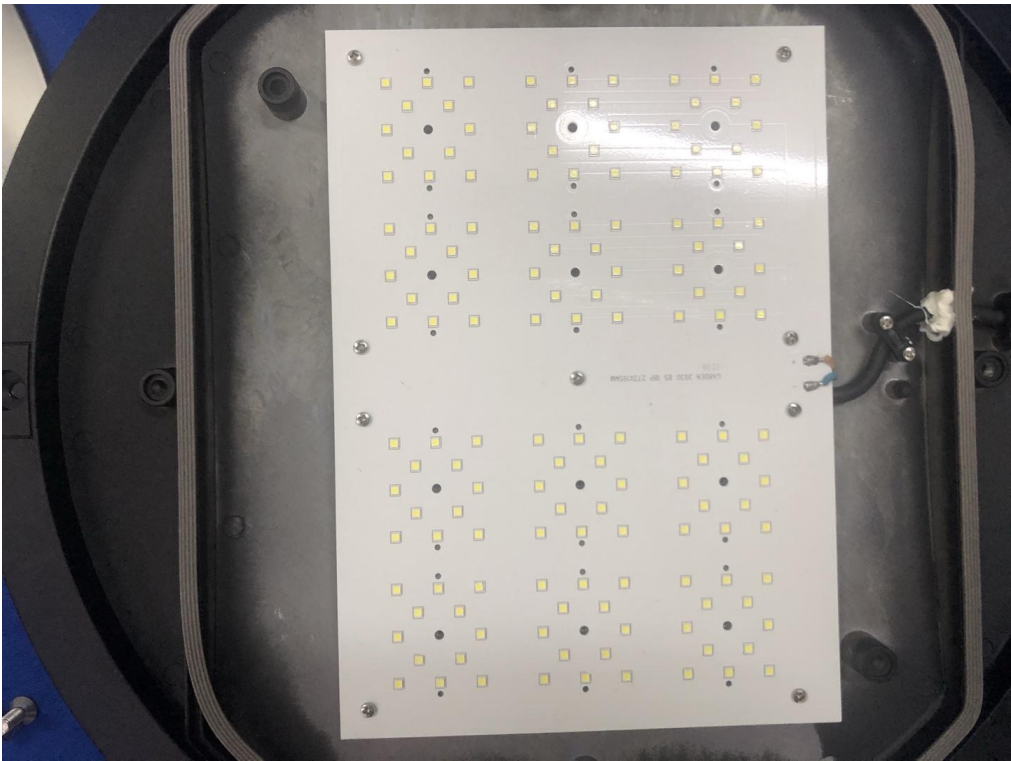


Figure 11. Internal view of sample series 3



Figure 12. LED driver view of model XLG-150-H-A

Attachment 3    Photo document.



Figure 13. LED driver view of model XLG-100-H-A  
-- END OF REPORT --